

Annual Air Quality Monitoring Report Blenheim 2023





**MARLBOROUGH
DISTRICT COUNCIL**

Annual Air Quality Monitoring Report - Blenheim 2023

MDC Technical Report No: 24-001

ISBN 1179-819 (Online)

ISBN 978-1-99-117368-3 (Online)

File Reference/Record No: E300-004-003-01/2424347

Date January 2024

Report Prepared for Marlborough District Council by
Emily Wilton
Environet Limited

Marlborough District Council
Seymour Square
PO Box 443
Blenheim 7240
Phone: 03 520 7400
Website: www.marlborough.govt.nz

Executive Summary

Particles in the air are the main air pollutant of concern in urban areas of New Zealand. The two size fractions of greatest concern are PM₁₀ (particles less than 10 microns in diameter) and PM_{2.5} (particles less than 2.5 microns in diameter). Measurements of PM₁₀ and PM_{2.5} were taken at the Redwoodtown monitoring site during 2023. The main source of PM₁₀ and PM_{2.5} in Blenheim during the winter is solid fuel burning for domestic home heating.

Monitoring data were compared to the National Environmental Standard for Air Quality (NES) of 50 µg m⁻³ (24-hour average) for PM₁₀, the proposed NES for PM_{2.5} (annual and 24-hour averages), the WHO (2021) guidelines and to the Ministry for the Environment's air quality guidelines and indicator categories. Comparisons are made with historical data to determine the likelihood of trends in concentrations.

Concentrations of PM₁₀ exceeded 50 µg/m³ in Blenheim on only one occasion during 2023. As the NES allows for one exceedance per year the NES was not breached for the 2023 calendar year. However, the exceedance does constitute a breach of the NES rather than an exceedance because it occurred less than a year after the previous exceedance in July 2022.

The maximum daily PM₁₀ concentration for 2023 was 54.5 µg/m³. The annual average PM₁₀ concentrations for 2023 was 14 µg/m³ and is the lowest annual average recorded at the site. This value compares with a guideline for annual PM₁₀ of 20 µg/m³.

Concentrations of PM_{2.5} exceeded 25 µg/m³ (24-hour average proposed NES) on 15 occasions. Monitoring for PM_{2.5} did not commence until June 2023. Typically, around two exceedances occur during May so the absence of data for this period is only likely to impact exceedance numbers slightly. The number of exceedances of the proposed PM_{2.5} NES in 2023 was significantly lower than previous years (prior minimum was 27 in 2022). The annual average PM_{2.5} concentration was estimated at around 11 µg/m³ but is unable to be accurately calculated because of missing data.

Management measures to reduce PM₁₀ concentrations to meet the NES have been included in the Proposed Marlborough Environment Plan (notified June 2016). Measures are based on a 2012 assessment which predicted concentrations would reduce from 2012 – 2018 in the absence of regulation. Potential reasons for the reductions not occurring include higher than anticipated emissions from newer burners and underestimated population increase in the airshed area from 2006 - 2013. Further evaluation of the effectiveness of the management options given the downward trend did not occur suggests that additional measures, for example targeting the operation of burners, would likely be required to achieve the NES for PM₁₀. However more recent monitoring data is supportive of significant reductions in PM₁₀. Ongoing compliance with the NES could be assessed by evaluating the extent to which 2021 – 2023 likely represented worst case meteorological conditions.

If the 24-hour average proposed NES for PM_{2.5} were introduced, reductions in daily winter PM_{2.5} concentrations would be required to be compliant and consequent air quality management required to meet this target would be likely be significant. If the NES for PM_{2.5} were reduced further in line with the 2021 WHO guideline revisions significant additional air quality management would likely be required.

Contents

1. Introduction	1
2. Methodology	4
2.1. Air quality monitoring sites	4
2.1.1. Redwoodtown monitoring site	4
2.2. Quality assurance	7
3. Air quality monitoring in Blenheim.....	8
3.1. PM₁₀ concentrations	8
3.2. PM_{2.5} concentrations.....	12
3.3. Particulate concentrations and meteorology in Blenheim	13
4. Trends in PM₁₀ concentrations in Blenheim	15
5. Summary.....	17
References	18

List of Figures

Figure 2.1: Location of air quality sites and NIWA metrological site in Blenheim	4
Figure 2.2: Aerial photo of the Redwoodtown air quality monitoring site (note: blue arrow depicts monitoring site).	5
Figure 2.3: PM ₁₀ monitor at the Redwoodtown – Bowling Club air quality monitoring site.	6
Figure 3.1: 24-hour average PM ₁₀ concentrations measured at the Redwoodtown – Bowling Club site during 2023.	8
Figure 3.2: Comparison of PM ₁₀ concentrations measured at Redwoodtown from 2006 to 2023 to air quality indicator categories.	9
Figure 3.3: Comparison of daily PM ₁₀ concentrations each month during 2023 to air quality indicator categories.	9
Figure 3.4: Number of days when 50 µg m ⁻³ was exceeded, the maximum concentration and the second highest concentration from 2006 to 2023.	10
Figure 3.5: 24-hour average PM _{2.5} concentrations measured at the Redwoodtown – Bowling Club site during 2023.	12
Figure 3.6: Summary PM _{2.5} concentrations from 2017 to 2023.	12
Figure 3.7: Hourly average PM ₁₀ , PM _{2.5} , wind speed, direction and temperature on days when PM ₁₀ concentrations exceeded 50 µg m ⁻³ (24 hour average).	13
Figure 3.8: Polar frequency plot of hourly wind data for Blenheim winter months (2023)	14
Figure 3.9: Polar plot of hourly average PM _{2.5} concentrations in Blenheim for winter 2023	14
Figure 3.10: Polar plot of hourly average PM ₁₀ concentrations in Blenheim for winter 2023	15
Figure 4.1: Trends in PM ₁₀ concentrations after adjusting for meteorological conditions	16

List of Tables

Table 1.1: National Environmental Standards for Ambient Air Quality (MfE, 2004)	2
Table 1.2: Ambient air quality guidelines for New Zealand (MfE, 2002)	2
Table 1.3: Environmental Performance Indicator categories for air quality (MfE, 2002)	3
Table 2.1: Site summary details for the Redwoodtown – Bowling Club air quality monitoring site.	6
Table 3.1: Summary of PM ₁₀ concentrations measured at Redwoodtown from 2006-2023	11

1. Introduction

The main air contaminant of concern in Blenheim and other urban areas of New Zealand is particulate or particles in the air. These are measured as PM₁₀, particles in the air less than 10 microns in diameter and PM_{2.5}, particles in the air less than 2.5 microns in diameter. The PM₁₀ size fraction forms the basis of the current National Environmental Standard (NES). However, it is well established that the smaller of these particles, those less than 2.5 microns in diameter are the greatest determinant of health impact. This is reflected in the Ministry for the Environment (2020) proposed NES which includes an annual and daily PM_{2.5} standard.

Table 1.1 shows the contaminant, the concentration, averaging period and allowable exceedances as required by the NES (Ministry for Environment, 2004). The NES for PM₁₀ is set at 50 µg m⁻³ with one allowable exceedance per 12-month period. Compliance with this target was required by September 2016 in Blenheim. All other areas in Marlborough must remain compliant with the NES.

The Ministry for the Environment's proposed revisions to the NES for particulate include the addition of an annual average PM_{2.5} of 10 µg/m³ and a daily average PM_{2.5} NES of 25 µg/m³. The existing NES for PM₁₀ (24-hour) was proposed to be retained. This signals the need for PM_{2.5} monitoring in addition to PM₁₀ monitoring. Monitoring of PM_{2.5} has been carried out in Blenheim since 2017.

In 2021 the World Health Organisation (WHO) released revised guidelines for PM₁₀ and PM_{2.5} including annual and daily guidelines for the latter. The revised WHO annual PM_{2.5} guideline value of 5 µg/m³ and daily guideline of 15 µg/m³ are significantly lower than the 2020 proposed NES values. The WHO also includes revised PM₁₀ guidelines of 15 µg/m³ (annual average) and 45 µg/m³ (daily average). As it is unclear which, if any, of the WHO guidelines the Ministry for the Environment will adopt for the NES review, the 2020 proposed NES values for PM_{2.5} are used for the reporting values for PM_{2.5} concentrations in this report.

This report summarises concentrations of PM₁₀ and PM_{2.5} that were measured in Blenheim during 2023.

Other air quality monitoring in the Marlborough Region includes monitoring of PM₁₀ at the MRR monitoring site from 2000 to 2019, intermittent monitoring of PM₁₀ at the Redwoodtown Bowling Club site, survey PM₁₀ monitoring in Renwick during 2000 and 2002, monitoring for PM₁₀ in Picton during 2008 and 2009, visibility surveys and passive sampling for nitrogen oxides and sulphur oxides. From 2007 to early 2008, PM₁₀ concentrations were measured at the Croquet Club in Redwoodtown in addition to the main monitoring site at the Bowling Club. A site on Brooklyn Street in Redwoodtown was temporarily used to measure PM₁₀ concentrations during 2004.

Air quality monitoring data in other urban areas of New Zealand indicates that it would seem unlikely that concentrations of NES contaminants other than particulate would be in breach in Blenheim for the current NES values. Concentrations of other contaminants even in large urban areas are typically within the NES and guideline concentrations. Because emissions of other contaminants in Blenheim are far lower than large urban areas such as Christchurch, it would seem unlikely that concentrations of other key urban air pollutants would be in breach of the NES or air quality guidelines. The exception to this may be benzo(a)pyrene concentrations, which appear to occur well in excess of guideline concentrations in Christchurch. Additionally, it is noted that NO₂ concentrations have also been revised downwards in the WHO 2021 guidelines as there is increased evidence of health impacts at lower concentrations than previously thought. This contaminant may require monitoring in the future.

The Ministry for the Environment also provides guidelines for ambient air quality (Ministry for Environment, 2002). Table 1.2 shows the ambient air quality guidelines and Table 1.3 details the air quality indicator categories to assist in the presentation and management of air quality in New Zealand. Air quality monitoring data in this report are presented relative to air quality guidelines and these indicator categories. These categories provide a useful perspective on the overall air quality and provide a valuable tool for evaluating trends in concentrations over time.

Table 1.1: National Environmental Standards for Ambient Air Quality (MfE, 2004)

Contaminant	NES values		
	Concentration	Averaging Period	Allowable exceedances / year
Particles (PM ₁₀)	50 µg m ⁻³	24-hour	1
Nitrogen dioxide	200 µg m ⁻³	1-hour	9
Sulphur dioxide	350 µg m ⁻³	1-hour	9
Sulphur dioxide	570 µg m ⁻³	1-hour	0
Ozone	150 µg m ⁻³	1-hour	0

Table 1.2: Ambient air quality guidelines for New Zealand (MfE, 2002)

Contaminant	2002 guideline values	
	Concentration	Averaging Period
Carbon monoxide	30 mg m ⁻³	1-hour
	10 mg m ⁻³	8-hour
Particles (PM ₁₀)	50 µg m ⁻³	24-hour
	20 µg m ⁻³	Annual
Nitrogen dioxide	200 µg m ⁻³	1-hour
	100 µg m ⁻³	24-hour
Sulphur dioxide ^b	350 µg m ⁻³	1-hour
	120 µg m ⁻³	24-hour
Ozone	150 µg m ⁻³	1-hour
	100 µg m ⁻³	8-hour
Hydrogen sulphide ^c	7 µg m ⁻³	1-hour
Lead ^d	0.2 µg m ⁻³ (lead content of PM ₁₀)	3-month moving, calculated monthly
Benzene (year 2002)	10 µg m ⁻³	Annual
Benzene (year 2010)	3.6 µg m ⁻³	Annual
1,3-Butadiene	2.4 µg m ⁻³	Annual
Formaldehyde	100 µg m ⁻³	30-minutes
Acetaldehyde	30 µg m ⁻³	Annual
Benzo(a)pyrene	0.0003 µg m ⁻³	Annual

Contaminant	2002 guideline values	
	Concentration	Averaging Period
Mercury (inorganic) ^d	0.33 µg m-3	Annual
Mercury (organic)	0.13 µg m-3	Annual
Chromium VI ^d	0.0011 µg m-3	Annual
Chromium metal and chromium III	0.11 µg m-3	Annual
Arsenic (inorganic) ^d	0.0055 µg m-3	Annual
Arsine	0.055 µg m-3	Annual

Notes for Table 1.2:

- ^a All values apply to the gas measured at standard conditions of temperature (0° C) and pressure (1 atmosphere).
- ^b The sulphur dioxide guideline values do not apply to sulphur acid mist.
- ^c The hydrogen sulphide value is based on odour nuisance and may be unsuitable for use in geothermal areas.
- ^d The guideline values for metals are for inhalation exposure only; they do not include exposure from other routes such as ingestion. These other routes should be considered in assessments where appropriate.

Table 1.3: Environmental Performance Indicator categories for air quality (MfE, 2002)

Category	Value relative to guideline	Comment
Excellent	Less than 10% of the guideline	Of little concern: if maximum values are less than a tenth of the guideline, average values are likely to be much less
Good	Between 10% and 33% of the guideline	Peak measurements in this range are unlikely to affect air quality
Acceptable	Between 33% and 66% of the guideline	A broad category, where maximum values might be of concern in some sensitive locations but generally they are at a level which does not warrant urgent action
Alert	Between 66% and 100% of the guideline	This is a warning level, which can lead to exceedances if trends are not curbed
Action	More than 100% of the guideline	Exceedances of the guideline are a cause for concern and warrant action, particularly if they occur on a regular basis

An emission inventory for Blenheim was updated in 2022 to provide a more recent estimate of the sources of PM₁₀ and other contaminant emissions (Wilton, 2022b). The results of the inventory indicated that domestic home heating was the main source of PM₁₀ emissions, contributing to around 94% of the daily wintertime PM₁₀. Motor vehicles contributed to 4% of PM₁₀ emissions, outdoor burning contributed to 1% and industry contributed to 1% of total wintertime emissions. Annual average PM₁₀ contributions were 87%, 10%, 1% and 2% respectively.

2. Methodology

Monitoring in Blenheim during 2023 was carried out at the Redwoodtown Bowling Club site in Blenheim. Two 5014i beta attenuation monitors (BAM) were used to continuously measure PM₁₀ and PM_{2.5}.

Prior to 2016, meteorological data, including wind speed, wind direction were obtained from a NIWA site on the outskirts of Blenheim. Ambient temperature data was collected at the Bowling Club site in Redwoodtown. All meteorological data (wind speed, temperature and wind direction) are now monitored at the Redwoodtown monitoring site.

2.1. Air quality monitoring sites

Figure 2.1 shows the Redwoodtown Bowling Club site which has been operational since 2002, the NIWA metrological monitoring site, which was used for meteorological data prior to 2016 and the MRR site, which was discontinued in 2019 and provides a historical record of PM₁₀ in Blenheim.

In 2007 a site at the Croquet Club was established for the purposes of evaluating the relationship between Brooklyn Street area PM₁₀ and PM₁₀ concentrations measured at the Bowling Club. This was considered important because PM₁₀ concentrations of the magnitude measured during 2004 at Brooklyn Street had not been measured at the Bowling Club and because the reductions required in PM₁₀ concentrations in Blenheim had been dependent on the Brooklyn Street results. The results from work undertaken in 2007 and reported in the '2007 Air Quality Monitoring Report' (Wilton, 2008) indicated that the Brooklyn Street site was likely to be affected by localised sources of PM₁₀ and should not be used for air quality management purposes. Details of the Croquet Club site are outlined in '2008 Air Quality Monitoring Report' (Wilton & Baynes, 2009).

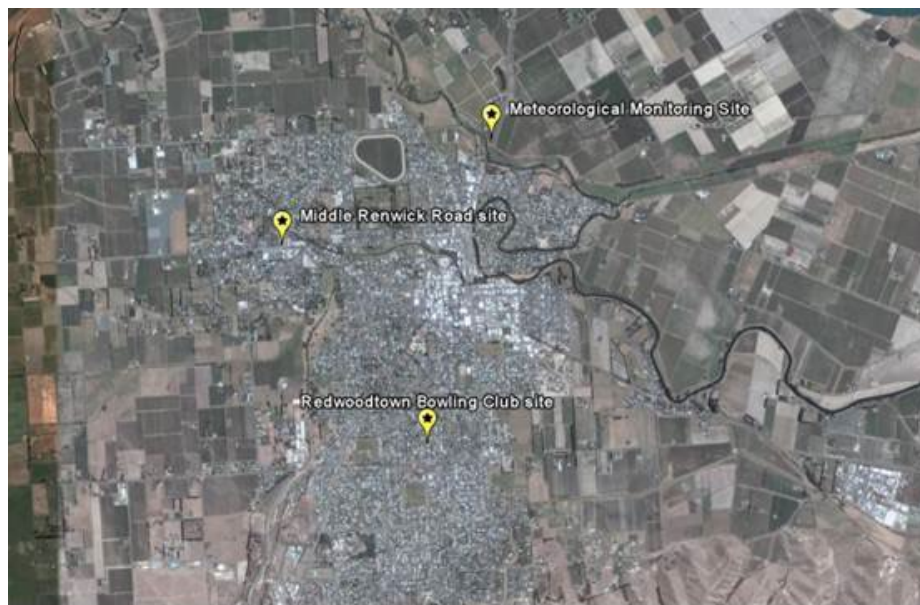


Figure 2.1: Location of air quality sites and NIWA metrological site in Blenheim

2.1.1. Redwoodtown monitoring site

In 2023 air quality monitoring took place at the main air quality monitoring site at the Blenheim Bowling Club on Weld Street in Redwoodtown. Figure 2.2 and Figure 2.3 show the surrounding area and the location of the monitoring site within the Bowling Club grounds. Summary site details are given in Table 2.1.



Figure 2.2: Aerial photo of the Redwoodtown air quality monitoring site (note: blue arrow depicts monitoring site).



Figure 2.3: PM₁₀ monitor at the Redwoodtown – Bowling Club air quality monitoring site.

Table 2.1: Site summary details for the Redwoodtown – Bowling Club air quality monitoring site.

Site name	Redwoodtown – Bowling Club
Site contact details	Marlborough District Council
Description of site	The site is located at the Blenheim Bowling Club, which is to the south-east of central Blenheim. The surrounding area includes a bowling green, gravel petanque area and paved areas.
Site category	Residential neighbourhood
Purpose of site and sources	To measure worst-case ambient air concentrations of PM ₁₀ in Blenheim. The main source during the winter months is solid fuel burning for domestic heating. The site is downwind of a large residential area for meteorological conditions conducive to poor air quality.
Proposed duration of monitoring	Ongoing
Contaminants monitored	PM ₁₀
Site co-ordinates	E1679764 N5402328
Date of site installation	Monitoring from 2000-2003. Permanent site since 2005.
Meteorological characteristics of area	Low wind speeds occur regularly during the winter months. Temperature inversions are likely.
Sample frequency	Continuous
Inlet height	3.5 metres
Averaging period	24-hour and hourly

2.2. Quality assurance

Operation of the BAM is carried out by Marlborough District Council (MDC) staff. Ten-minute data is recorded by the instrument and logged by an iQuest iRIS 350 datalogger. The BAM filter spot is moved on every eight hours. Results are telemetered hourly to MDC and stored in the hilltop database. Annual calibrations have been carried out by MDC staff during the 2020 – 2023 period owing to covid travel restrictions and costs.

3. Air quality monitoring in Blenheim

3.1. PM₁₀ concentrations

In 2023 there was only one exceedance of 50 $\mu\text{g}/\text{m}^3$ at the Redwoodtown air quality monitoring site (Figure 3.1) which occurred on 5 July 2023 with a concentration of 54.5 $\mu\text{g}/\text{m}^3$. The NES allows one exceedance of 50 $\mu\text{g}/\text{m}^3$ per year before a breach occurs. The NES was therefore not breached in Blenheim for the 2023 calendar year. However, the exceedance does count as a breach for the purposes of NES reporting because it occurred within a year of the previous exceedance (6 July 2022). This is the third calendar year that Blenheim has not breached the NES with the previous occasions being 2019 and 2022.

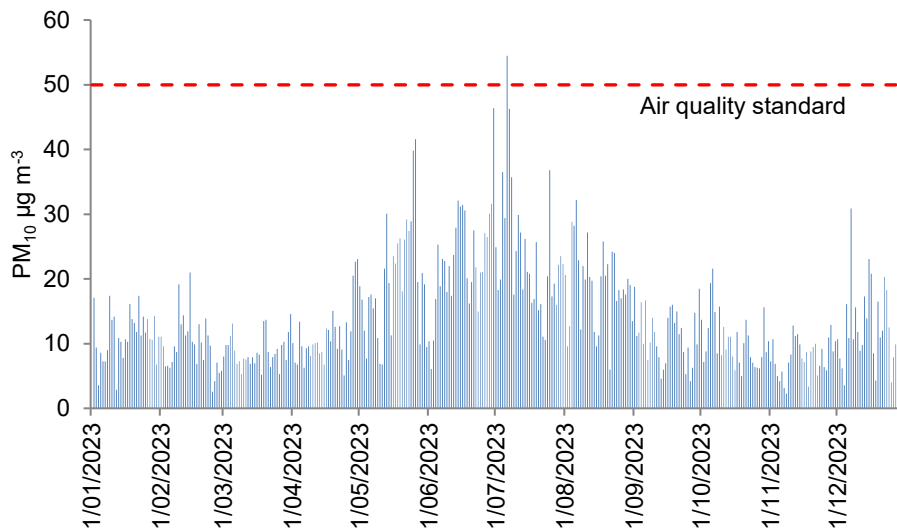


Figure 3.1: 24-hour average PM₁₀ concentrations measured at the Redwoodtown – Bowling Club site during 2023.

Daily PM₁₀ concentrations measured from 2006 to 2023 relative to the MfE air quality indicator categories (shown in Table 1.3) are illustrated in Figure 3.2. Similarly, monthly variations in the distribution of PM₁₀ concentrations for 2023 are shown in Figure 3.1. The distribution of PM₁₀ concentrations by season are similar to other years with the winter months showing the greatest proportion of days in the “acceptable”, “alert” and “action” categories and fewer days in the “good” category.

Figure 3.4 compares the number of days when 50 $\mu\text{g}/\text{m}^3$ was exceeded in 2023 to previous years along with the maximum concentration and the second highest concentration. It is important to note, that comparisons between years does not take into account year to year variations in the impact of meteorology. This issue is examined further in section 4 of this report.

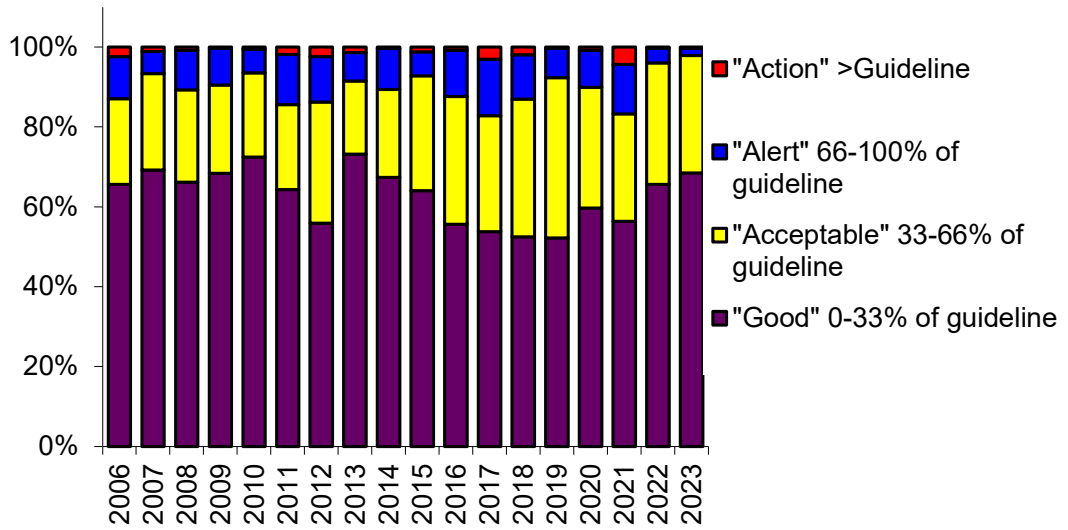


Figure 3.2: Comparison of PM₁₀ concentrations measured at Redwoodtown from 2006 to 2023 to air quality indicator categories.

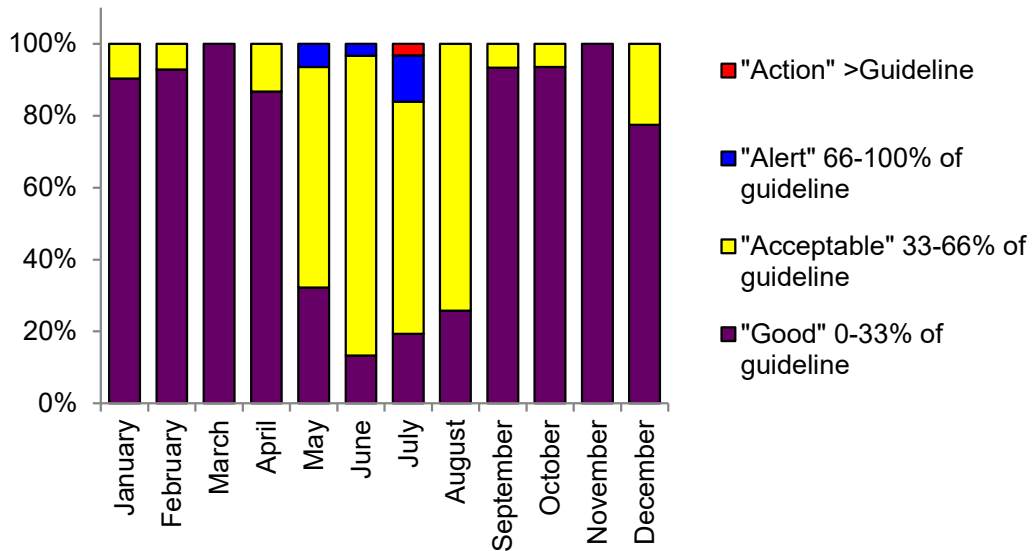


Figure 3.3: Comparison of daily PM₁₀ concentrations each month during 2023 to air quality indicator categories.

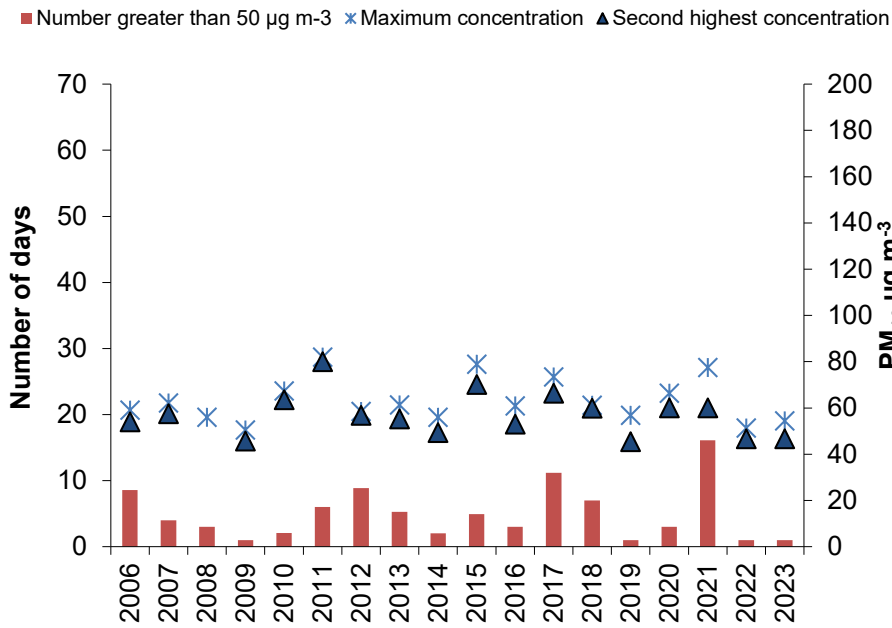


Figure 3.4: Number of days when 50 µg m⁻³ was exceeded, the maximum concentration and the second highest concentration from 2006 to 2023.

The annual average PM₁₀ concentration for 2023 was 14 µg m⁻³ and is the lowest annual average concentrations measured at the site. The Ministry for the Environment specifies an annual average guideline for PM₁₀ of 20 µg m⁻³. The NES does not currently include an annual average concentration for PM₁₀ although this currently being reviewed as part of the proposed revisions to the NES. The revised WHO guidelines specify an annual average for PM₁₀ of 15 µg/m³.

Summary statistics for PM₁₀ monitoring results from the Redwoodtown Bowling Club site from 2006 to 2023 are provided in Table 3.1. Data from 2016 has been adjusted for gravimetric equivalency.

Table 3.1: Summary of PM₁₀ concentrations measured at Redwoodtown from 2006-2023

	2006*	2007*	2008*	2009*	2010*	2011*	2012*	2013*	2014*	2015*	2016	2017	2018	2019	2020	2021	2022	2023
Monitoring method	BAM	BAM	BAM	BAM	BAM	BAM	BAM/Hi-vol	BAM	BAM/Hi-vol	BAM/Hi-vol	BAM	BAM	BAM	BAM	BAM	BAM	BAM	BAM
"Good" 0-33% of guideline	66%	69%	66%	68%	72%	64%	56%	72%	67%	64%	56%	54%	53%	52%	60%	56%	66%	68%
"Acceptable" 33-66% of guideline	21%	24%	23%	22%	21%	21%	31%	18%	22%	29%	32%	29%	34%	40%	30%	27%	30%	29%
"Alert" 66-100% of guideline	10%	6%	10%	9%	6%	13%	11%	7%	10%	6%	12%	14%	11%	7%	9%	12%	4%	2%
"Action" >Guideline	3%	1%	1%	0%	1%	2%	2%	1%	0%	1%	1%	3%	2%	0%	1%	4%	0%	0%
Percentage of valid data	68%	99%	99%	98%	96%	87%	91%	98%	70%	91%	95%	99%	99%	99%	100%	100%	96%	100%
Annual average ($\mu\text{g m}^{-3}$)	17	15	17	15	14	16	19	14	16	17	18	20	19	18	18	19	15.0	14
Measured PM ₁₀ concentrations above 50 $\mu\text{g m}^{-3}$	6	5	3	1	2	6	8	5	1	4	3	11	7	1	3	16	1	1
Extrapolated PM ₁₀ concentrations above 50 $\mu\text{g m}^{-3}$	10	4	3	1	2	6	9	5	2	5	3	11	7	1	3	16	1	1
Second highest PM ₁₀ concentration ($\mu\text{g m}^{-3}$)	54	58	56	46	64	80	57	55	51	70	53	66	60	46	60	60	47	46
Annual maximum ($\mu\text{g m}^{-3}$)	59	62	56	46	67	82	59	61	56	79	61	74	61	57	66	78	51	55
Number of records	247	360	363	357	352	319	331	351	254	331	346	361	360	362	364	364	349	365

*Not adjusted for gravimetric equivalency

3.2. PM_{2.5} concentrations

In 2020 the Ministry for the Environment proposed a daily NES for PM_{2.5} of 25 µg/m³ and an annual NES of 10 µg/m³ (Ministry for the Environment, 2020). PM_{2.5} is generally accepted as the main air quality indicator for particulate in terms of health impacts with the long-term exposure period being the most significant in terms of impact on health. In 2021 WHO released revised guidelines for PM_{2.5} of 5 µg/m³ (annual average). During 2023 monitoring for PM_{2.5} was unable to commence until 7 June and therefore a calculation of annual average concentration is not possible. An estimate of around 11 µg/m³ was made assuming 2022 averages for the months January to May.

During 2023 there were 15 exceedances of the 24-hour average reporting guideline for PM_{2.5} of 25µg/m³ at the Redwoodtown air quality monitoring site (Figure 3.5). Whilst this excludes data for May historically only two exceedances have occurred in May. The exceedance frequency is therefore lower than the 27 and 38 exceedances recorded in 2021 and 2022 respectively. The maximum measured PM_{2.5} concentration for 2023 was 49 µg/m³. Figure 3.6 shows the changes in the annual average, maximum and fourth highest daily PM_{2.5} concentrations at Redwoodtown since monitoring commenced in 2017. Results suggest a downward trend in PM_{2.5} concentrations since 2017.

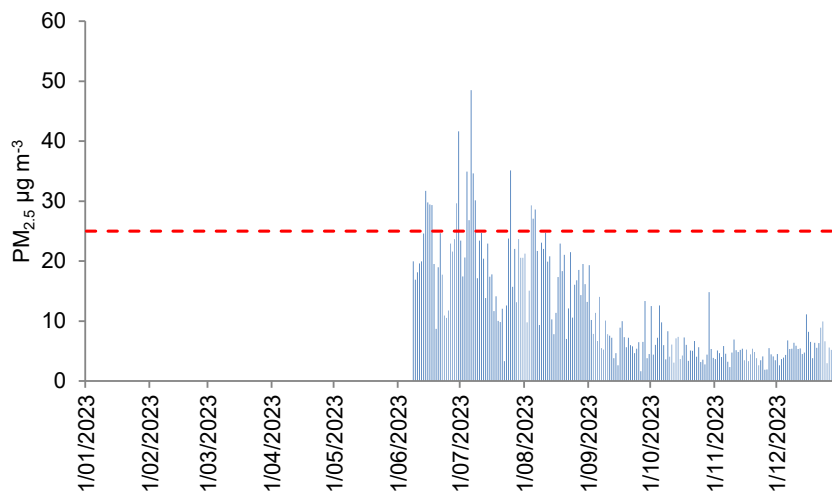


Figure 3.5: 24-hour average PM_{2.5} concentrations measured at the Redwoodtown – Bowling Club site during 2023.

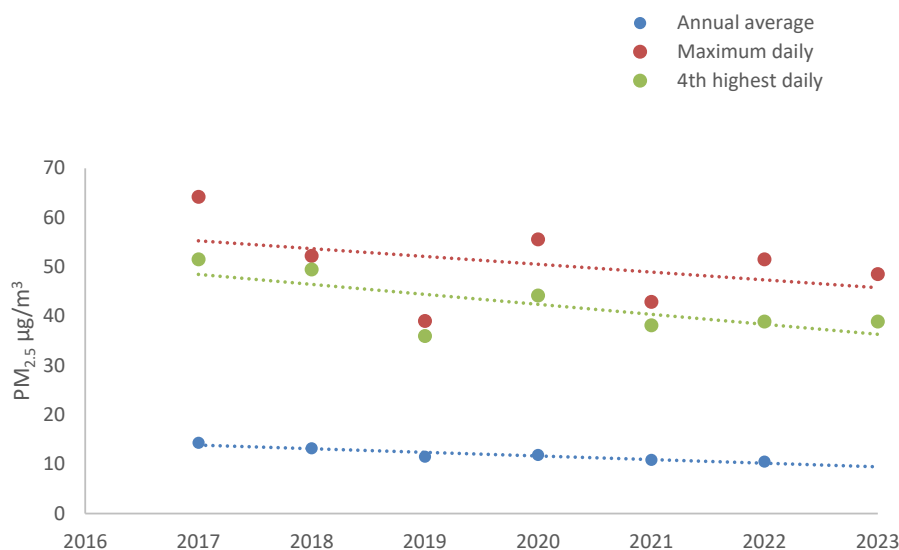


Figure 3.6: Summary PM_{2.5} concentrations from 2017 to 2023.

3.3. Particulate concentrations and meteorology in Blenheim

Daily variations in PM₁₀ and PM_{2.5} concentrations and meteorological conditions on 5 July when PM₁₀ concentrations exceeded 50 µg m⁻³ at the monitoring site are shown in Figure 3.7. Data are consistent with historical high pollution days with peak PM₁₀ concentrations occurring during the evening and typically a smaller peak occurring mid-morning. The key meteorological conditions associated with the elevated concentrations on high pollution days are low wind speeds and south-westerly wind direction.

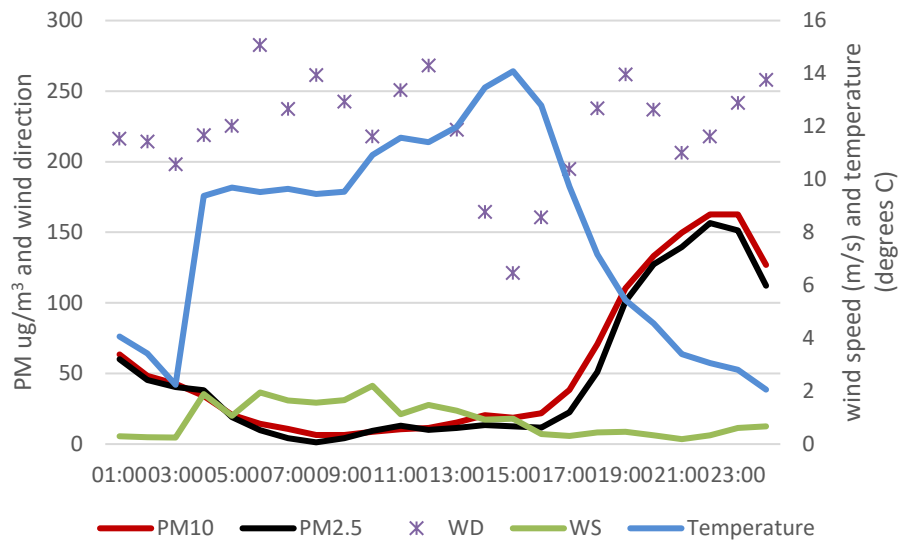


Figure 3.7: Hourly average PM₁₀, PM_{2.5}, wind speed, direction and temperature on days when PM₁₀ concentrations exceeded 50 µg m⁻³ (24 hour average).

Figure 3.8 shows the frequency distribution of wind speed and direction for the winter period in Blenheim based on hourly data and segmented wind data (10-degree wind direction and 1 ms⁻¹ wind speed segments). The most frequent winds are directions between 220 and 260 degrees and wind speeds less than 1 ms⁻¹.

Polar plots of PM_{2.5} and PM₁₀ concentrations in Blenheim are shown in Figure 3.9 and Figure 3.10. These illustrate hourly average concentrations by wind speed and direction. Whilst the PM_{2.5} plot is relatively consistent with elevated concentrations occurring when wind speeds are low, the PM₁₀ plots illustrate a source of coarse mode (PM₁₀-PM_{2.5}) concentrations occurring with wind speeds greater than 5 ms⁻¹ from a southeast wind direction. Sources that might result in coarse mode particulate concentrations under high wind speeds include unpaved yards, storage of aggregates, earthworks or construction sites.

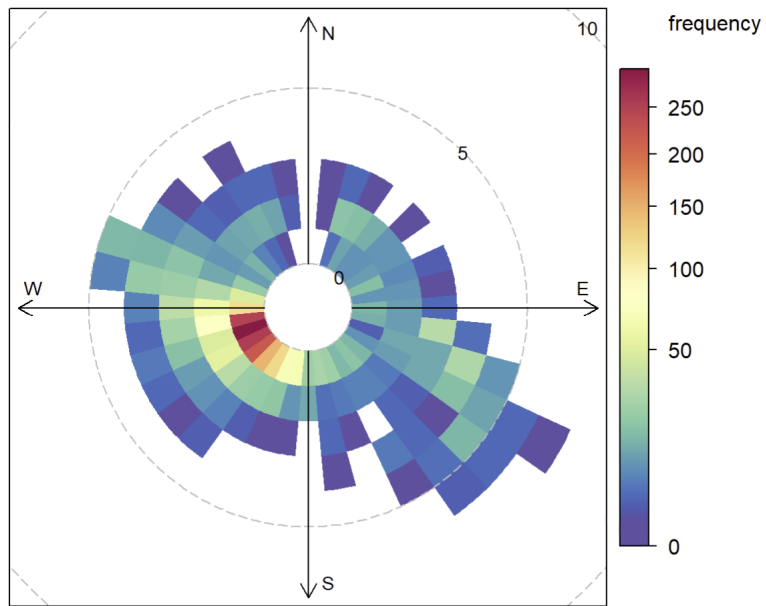


Figure 3.8: Polar frequency plot of hourly wind data for Blenheim winter months (2023)

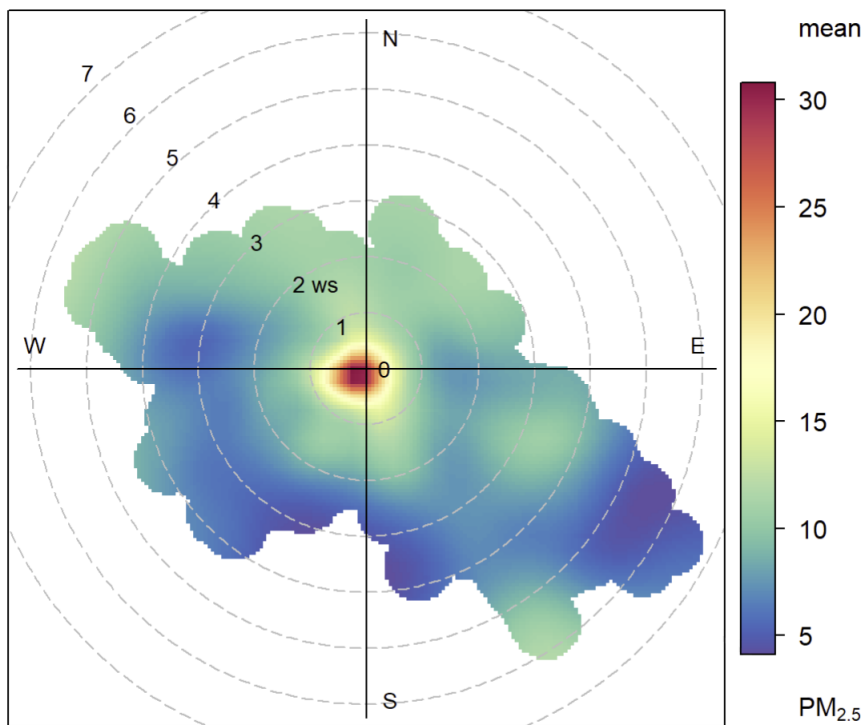


Figure 3.9: Polar plot of hourly average $PM_{2.5}$ concentrations in Blenheim for winter 2023

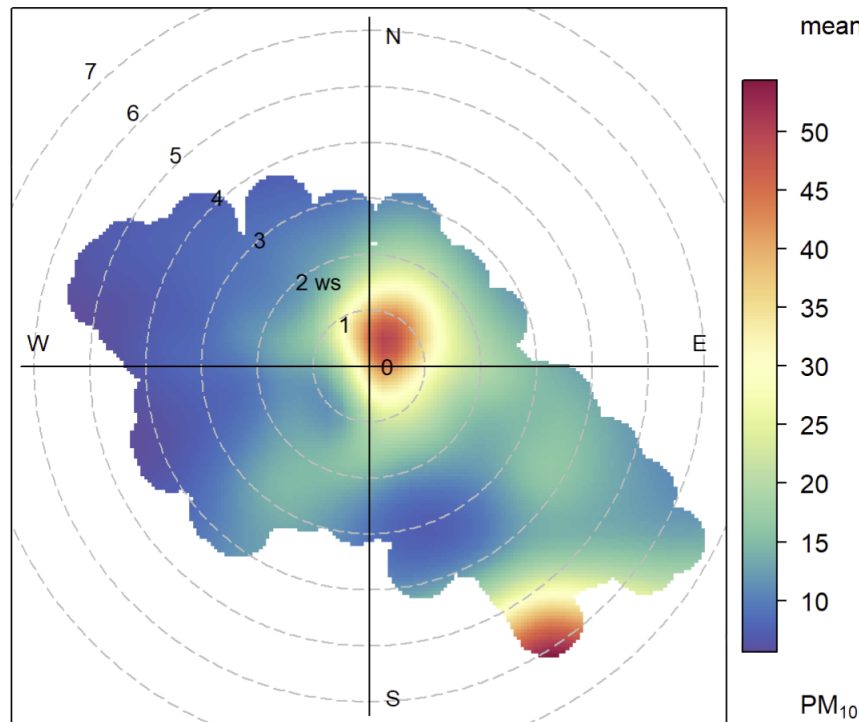


Figure 3.10: Polar plot of hourly average PM₁₀ concentrations in Blenheim for winter 2023

4. Trends in PM₁₀ concentrations in Blenheim

To quantify the impact of meteorological conditions and therefore further assess the likelihood of changes in PM₁₀ concentrations since 2005, a trends assessment was updated in 2012 (Wilton, 2012). The objective of that work was to identify meteorological conditions giving rise to concentrations of PM₁₀ in excess of the NES and to provide a tool for comparing year to year PM₁₀ concentrations whilst minimising the impact of variability in meteorological conditions. The trends assessment provided a tool for updating the trends analysis with time. Figure 4.1 shows trends in PM₁₀ concentrations updated with the 2023 PM₁₀ data adjusted for the impact of meteorological conditions.

Results for 2023 are relatively consistent, albeit slightly higher than 2022 data which was lower than any previous values for all PM₁₀ indicators. Previous assessments had concluded that the data are not indicative of overall improvement or degradation in PM₁₀ concentrations in Blenheim and that no trend was evident. However, if the 2021 data are disregarded owing to a localised source contributing to PM₁₀ that year, as discussed in the 2021 air quality monitoring report (Wilton, 2022a), then 2022 and 2023 data are likely indicative of a downward trend in PM₁₀. This is supported by the PM_{2.5} data which suggests a reduction in concentrations since 2017.

A key question for PM₁₀ in Blenheim is whether reductions in PM₁₀ have been sufficient to ensure that the NES will be met under worst case meteorological conditions. It is likely that worst case meteorological conditions than those experienced during 2023 will occur and these would likely result in greater than one exceedance of 50 µg/m³. Ongoing compliance with the NES is therefore likely to depend on emission reductions continuing beyond 2023. An assessment of the impact of management measures using worst case meteorological conditions (Wilton & Zawar-Reza, 2018) suggests further reductions in emission are likely to be required for ongoing compliance. A minimum of five years with no breaches is required for an airshed to no longer be considered polluted.

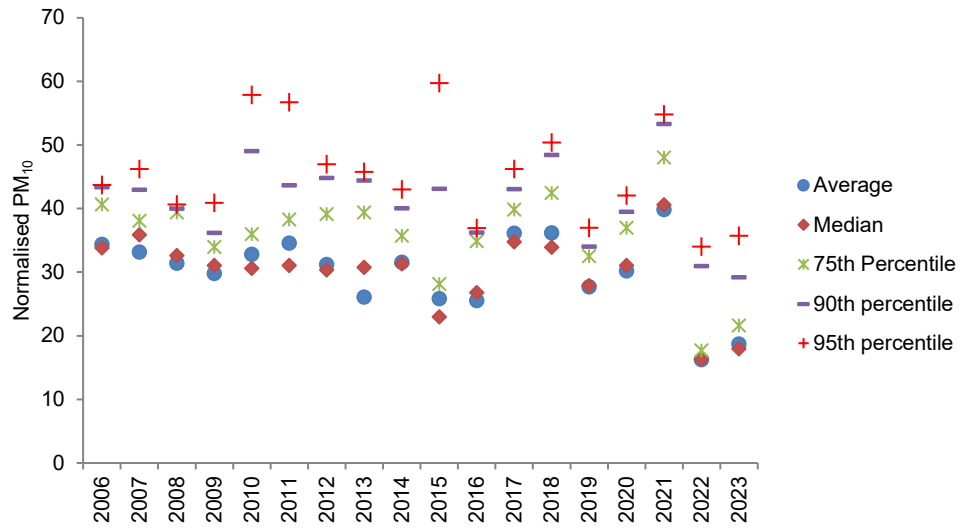


Figure 4.1: Trends in PM₁₀ concentrations after adjusting for meteorological conditions

5. Summary

Like 2022, during 2023 there was only one exceedance of $50 \mu\text{g}/\text{m}^3$ (24-hour average) for PM_{10} in Blenheim for the calendar year. As one exceedance per year is tolerated, there were no breaches of the NES for PM_{10} for the 2023 calendar year. However, as the exceedance has occurred within 365 days of the previous exceedance this is considered a breach of the NES. The maximum PM_{10} concentration in 2023 was $54.5 \mu\text{g}/\text{m}^3$ (24-hour average).

The annual average PM_{10} concentration for 2023 was $14 \mu\text{g}/\text{m}^3$ and is the lowest concentrations measured since the NES was introduced. Data for 2023 is consistent with there being a decrease PM_{10} concentrations in Blenheim over time. It is unclear if compliance with the NES for PM_{10} will be achieved and it is likely that further emission reductions will be required to meet the PM_{10} target. An airshed must be compliant with the NES for PM_{10} for five consecutive years to be considered non-polluted.

Monitoring of $\text{PM}_{2.5}$ in Blenheim suggests that both annual and 24-hour average concentrations exceed the proposed NES for $\text{PM}_{2.5}$. The maximum and fourth highest $\text{PM}_{2.5}$ concentrations were $49 \mu\text{g}/\text{m}^3$ and $39 \mu\text{g}/\text{m}^3$ respectively and compare with a proposed daily NES of $25 \mu\text{g}/\text{m}^3$ and the WHO guideline of $15 \mu\text{g}/\text{m}^3$. The proposed daily NES for $\text{PM}_{2.5}$ ($25 \mu\text{g}/\text{m}^3$) was exceeded on 15 occasions during 2023, although the monitoring period excluded May when a small number of exceedances also typically occur. Significant reductions would be required should a daily $\text{PM}_{2.5}$ NES be introduced as a standard. Data are indicative of a downward trend, but further monitoring is required to confirm this.

Management measures to reduce PM_{10} concentrations to meet the NES have been included in the in the Proposed Marlborough Environment Plan (notified June 2016). Measures are based on a 2012 assessment which predicted concentrations would reduce from 2012 to 2018 in the absence of regulation. This reduction did not occur, but it is possible that households delayed replacing burners until the regulations became effective in 2022. An analysis by Wilton & Zawar-Reza, (2018) suggests additional measures to the Marlborough Environment Plan are likely to be required and that additional measures such as a behaviour change programme targeting household's operation of wood burners may be necessary. That is, it is likely that meteorological conditions more conducive to elevated pollution than those experienced during 2023 will occur and these would likely result in greater than one exceedance of $50 \mu\text{g}/\text{m}^3$.

A key air quality management scenario would arise if the proposed short term (24-hour average) NES for $\text{PM}_{2.5}$ of $25 \mu\text{g}/\text{m}^3$ or lower (e.g., WHO guideline) were introduced. Data indicates both high $\text{PM}_{2.5}$ concentrations and a high frequency of exceedances. The reductions in particulate concentrations and consequent air quality management required to meet this target would be likely be significant.

References

- Ministry for the Environment. (2020). *Proposed amendments to the National Environmental Standards for Air Quality, particulate matter and mercury emissions*. Ministry for Environment.
- Ministry for Environment. (2002). *Ambient Air Quality Guidelines – 2002*. Ministry for Environment.
- Ministry for Environment. (2004). *Resource Management (National Environmental Standards for Air Quality) Regulations 2004*. New Zealand Government.
http://www.legislation.govt.nz/regulation/public/2004/0309/latest/DLM286835.html?search=ts_regulation_air+quality_rese&p=1&sr=1
- Wilton, E. (2008). *Annual air quality monitoring report 2007*. Marlborough District Council Report.
- Wilton, E. (2012). *Assessing trends in PM10 concentrations in Blenheim—2011*. Marlborough District Council Report.
- Wilton, E. (2022a). *Annual Air Quality Monitoring Report – Blenheim 2021*. Marlborough District Council Report.
- Wilton, E. (2022b). *Blenheim Air Emission Inventory—2022*. Marlborough District Council Report.
- Wilton, E., & Baynes, M. (2009). *Annual air quality monitoring report for Blenheim and Picton—2008*. Marlborough District Council Report.
- Wilton, E., & Zavar Reza, P. (2018). *Air quality in Blenheim – assessing the effectiveness of management options to reduce PM10*. Marlborough District Council Report.